

**CLIENT:** GEOPLAST S.P.A.  
VIA MARTIRI DELLA LIBERTA' 6/8  
35010 GRANTORTO (PD)

**OBJECT:** Factory product control

**TYPE OF SAMPLE:** Molds for ventilated crawl space

**SAMPLE:** Molds H30 base 71x71cm

**FACTORY:** Factory in Grantorto (PD)


**SAMPLING:** Executed by producer

**DELIVERY SAMPLES DATE:** 29-02-08

**TESTS:** 1) Determination of resistance to concentrated load (UNI 9730-3:1990 - D.M. 09/01/96 All. 7 mod.)

**TESTING DATE:** from 14-03-08 to 14-03-08

**PHOTO SAMPLE:**

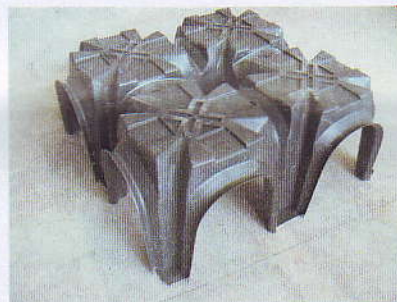

TEST REPORT n° 15097

Acceptation n° 5836 of 29-02-08

**TEST 1): DETERMINATION OF RESISTANCE TO CONCENTRATED LOAD (UNI 9730-3:1990 - D.M. 09/01/96 All. 7 mod.)**

**Procedure:** The load was applicated with a prismatic section 80x80 mm as requested by the client.  
The load was applicated at the center of the sample 35x35 cm up to failure by rapture of the specimens.

Sample	Maximum Load
n°	kN
1	2,1
2	2,0
3	1,9
4	1,8
5	2,2
6	2,0
7	1,9
8	2,1
9	1,9
10	2,0

Monte di Malo, 17-03-08



The experimenter  
Dott. Andrea Zanrosso



Building Product Sector  
The Director  
dott. geol. Danilo Belli

*This test report refers only to samples tested only and may not be reproduced unless prior written permission o f the laboratory.*